



CABLEMASTER REMOTE CONTROL WIRING DIAGRAM

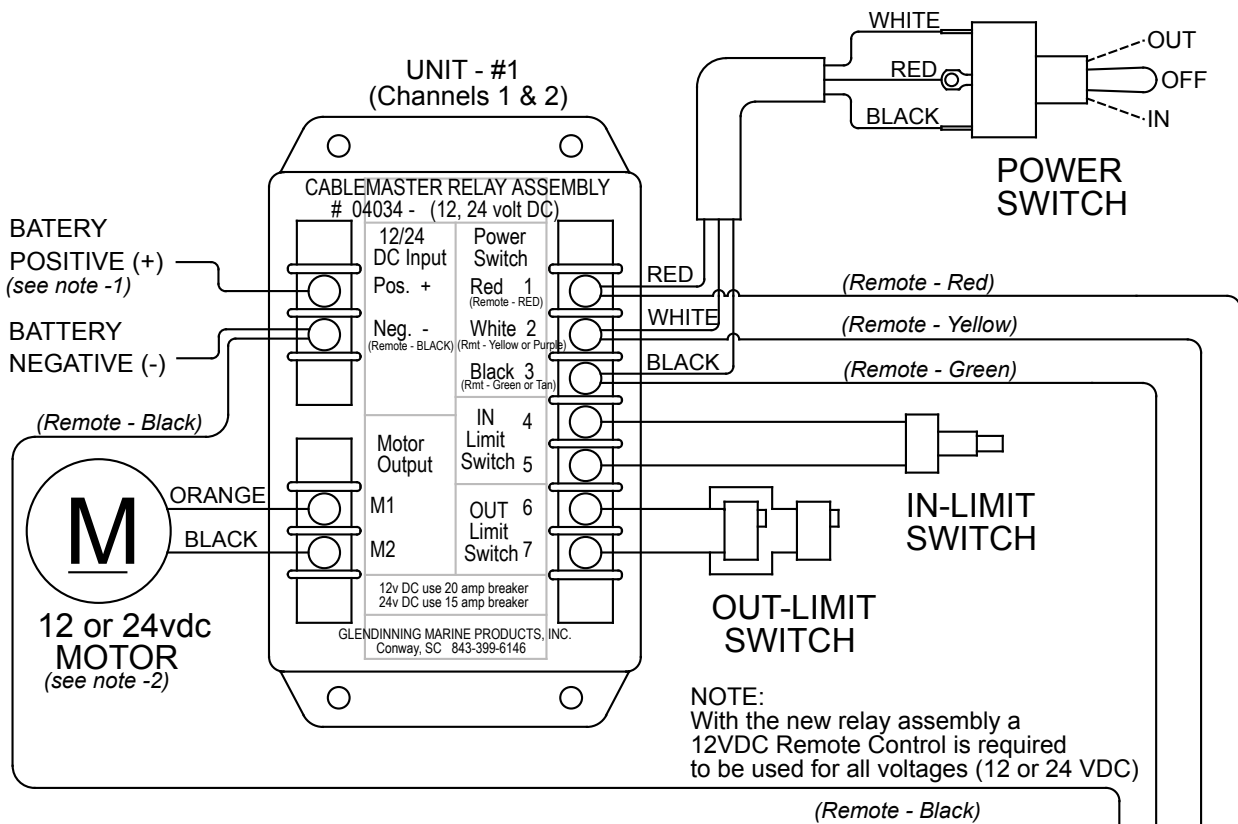

(if operating 2 Cablemasters)

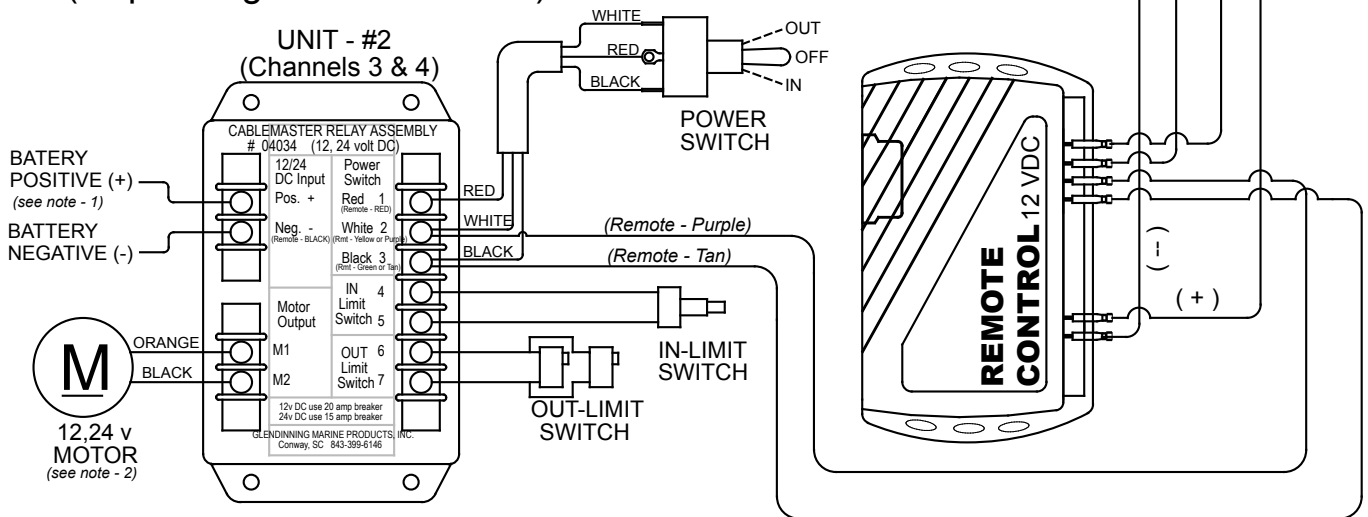

Note:


- 1.) Connect battery positive lead via fuse or circuit breaker. See Installation Manual for rating.

Circuit Breaker Specs.:


CM7 - 12 Volt 20 Amp Breaker 8-10 Running Amps
CM7 - 24 Volt 15 Amp Breaker 5-6 Running Amps

- 2.) For low profile Cablemaster installation, the motor leads must be reversed for correct limit switch operation. See manual for more information.

04155_remote_wire.eps Version - 2.0

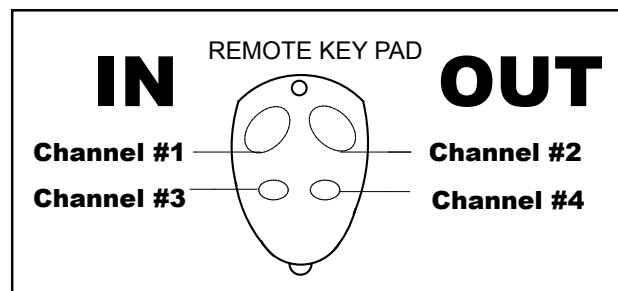


CM-7 CABLEMASTER EXTERNAL WIRING (Old Style)

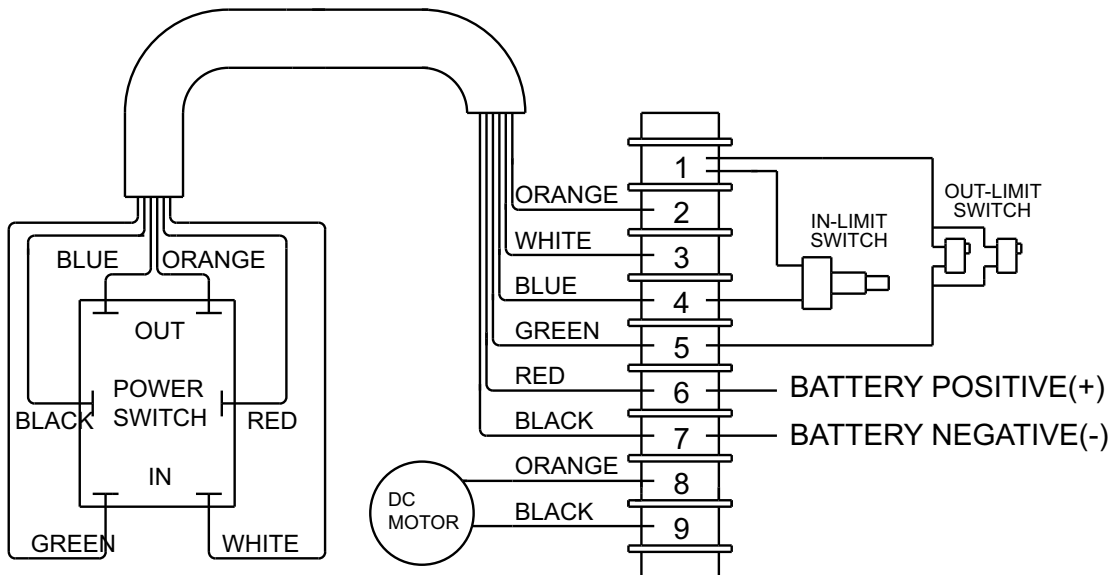

NOTE: Connect battery positive lead via fuse or circuit breaker.
See Installation Manual for rating.

CIRCUIT BREAKER SPECS. :
 CM7 - 12 VOLT 20 AMP BREAKER 8-10 RUNNING AMPS
 CM7 - 24 VOLT 10 AMP BREAKER 5-6 RUNNING AMPS
 CM7 - 32 VOLT 10 AMP BREAKER 5-6 RUNNING AMPS

CM-7 CABLEMASTER EXTERNAL WIRING (New Style)

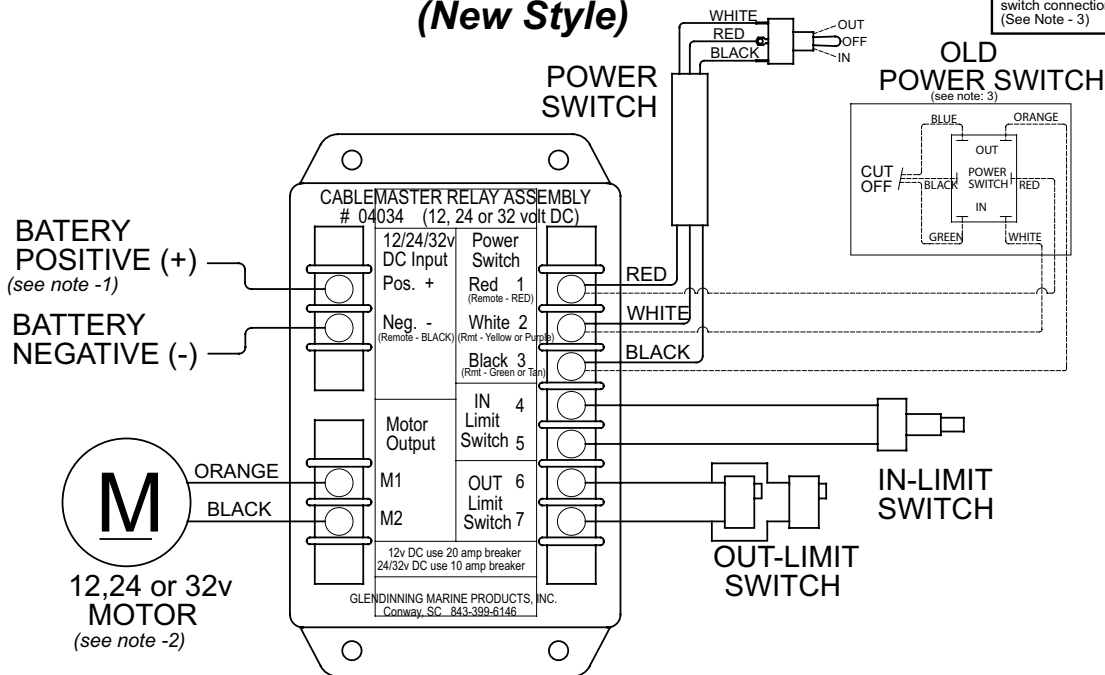

Note

1.) Connect battery positive lead via fuse or circuit breaker.
See Installation Manual for rating.

2.) For low profile Cablemaster installation, the motor leads must be reversed for correct limit switch operation.
See manual for more information.

Circuit Breaker Specs.:
 CM7 - 12 Volt 20 Amp Breaker 8-10 Running Amps
 CM7 - 24 Volt 10 Amp Breaker 5-6 Running Amps
 CM7 - 32 Volt 10 Amp Breaker 5-6 Running Amps

3.) To connect 6 wire Power Switch to New Relay Attach:
 -RED wire to #1 pos. on relay barrier strip.
 -WHITE wire to #2 pos. on relay barrier strip.
 -ORANGE wire to #3 pos. on relay barrier strip.
 Then remove blue, black, and green wires on the Power Switch.